



Operating Instructions

IO-Link Master with PROFINET Interface
StandardLine
8 Ports
IP 65 / IP 66 / IP 67 / IP 69K

AL1103

Firmware: 2.2.x or higher
LR DEVICE: 1.4.0.x or higher

English

Contents

1	Preliminary note	5
1.1	Legal and copyright information	5
1.2	Purpose of the document	5
1.3	Explanation of Symbols	6
1.4	Modification history	6
2	Safety instructions	7
2.1	General	7
2.2	Required background knowledge	7
2.3	Safety symbols on the device	7
2.4	Tampering with the unit	7
3	Intended use	8
3.1	Permitted use	8
3.2	Prohibited use	8
4	Function	9
4.1	Communication, parameter setting, evaluation	10
4.1.1	IO-Link	10
4.1.2	PROFINET	10
4.1.3	Parameter setting	10
4.1.4	Visual indication	10
4.2	Digital inputs	11
4.3	IO-Link supply	11
5	Mounting	12
5.1	Mount the device	12
6	Electrical connection	13
6.1	Notes	13
6.2	Ethernet ports	14
6.3	IO-Link ports	15
6.3.1	Connect IO-Link devices for Class A operation	15
6.4	Connect the device	16
7	Operating and display elements	17
7.1	Overview	17
7.2	LED indicators	18
7.2.1	Status LEDs	18
7.2.2	Ethernet interface	18
7.2.3	Voltage supply	19
7.2.4	IO-Link ports (Class A)	19

8	Set-up	20
8.1	Read device and diagnostic information	21
9	Configuration	22
9.1	LR DEVICE	23
9.1.1	Remarks	24
9.1.2	IoT: Configure access rights	25
9.1.3	IoT: Configure the interface to the LR SMARTOBSERVER	26
9.1.4	Fieldbus: Set PROFINET interface	26
9.1.5	IO-Link ports: Activate data transfer to the LR SMARTOBSERVER	27
9.1.6	IO-Link ports: Configure operating mode	28
9.1.7	IO-Link ports: Set the device validation and data storage	29
9.1.8	Firmware: Reset device to factory settings	30
9.1.9	Firmware: Reboot the device	30
9.1.10	Configure IO-Link devices	31
9.2	PROFINET	32
9.2.1	Install GSD Files	33
9.2.2	Integrate the IO-Link master in the project	33
9.2.3	Configure the IO-Link master	34
9.2.4	Configure IO-Link ports	35
9.2.5	Configure IO-Link devices	36
9.2.6	Read and write cyclic process data	37
9.2.7	Read I&M datasets	38
9.2.8	Detect diagnostics and alarms	38
10	Maintenance, repair and disposal	39
10.1	Cleaning process	39
10.2	Firmware update	40
10.3	Replace IO-Link device	41
11	Factory settings	42
12	Accessories	43
13	Appendix	44
13.1	Technical data	45
13.1.1	Application	45
13.1.2	Electrical data	45
13.1.3	Inputs / outputs	45
13.1.4	Inputs	46
13.1.5	Outputs	46
13.1.6	Interfaces	46
13.1.7	Operating conditions	47
13.1.8	Approvals / tests	47
13.1.9	Mechanical data	47
13.1.10	Electrical connection	48
13.2	PROFINET	49
13.2.1	Parameter data	49
13.2.2	Cyclic data	52
13.2.3	Acyclic data	54
14	Index	57

1 Preliminary note

Content

Legal and copyright information	5
Purpose of the document	5
Explanation of Symbols	6
Modification history	6

33203

1.1 Legal and copyright information

33117

© All rights reserved by ifm electronic gmbh. No part of this manual may be reproduced and used without the consent of ifm electronic gmbh.

All product names, pictures, companies or other brands used on our pages are the property of the respective rights owners:

- AS-i is the property of the AS-International Association, (→ www.as-interface.net)
- CAN is the property of the CiA (CAN in Automation e.V.), Germany (→ www.can-cia.org)
- CODESYS™ is the property of the 3S – Smart Software Solutions GmbH, Germany (→ www.codesys.com)
- DeviceNet™ is the property of the ODVA™ (Open DeviceNet Vendor Association), USA (→ www.odva.org)
- EtherNet/IP® is the property of the → ODVA™
- EtherCAT® is a registered trade mark and patented technology, licensed by Beckhoff Automation GmbH, Germany
- IO-Link® (→ www.io-link.com) is the property of the → PROFIBUS Nutzerorganisation e.V., Germany
- ISOBUS is the property of the AEF – Agricultural Industry Electronics Foundation e.V., Deutschland (→ www.aef-online.org)
- Microsoft® is the property of the Microsoft Corporation, USA (→ www.microsoft.com)
- PROFIBUS® is the property of the PROFIBUS Nutzerorganisation e.V., Germany (→ www.profibus.com)
- PROFINET® is the property of the → PROFIBUS Nutzerorganisation e.V., Germany
- Windows® is the property of the → Microsoft Corporation, USA

1.2 Purpose of the document

34227

This document is only for device types "IO-Link master - PROFINET gateway (StandardLine) 8 port IP 65 / IP 66 / IP 67 / IP 69K" (art. no.: AL1103).

It is part of the device and contains information about the correct handling of the product.

- ▶ Read this document before using the device.
- ▶ Keep this document during the service life of the device.

1.3 Explanation of Symbols

34171



WARNING!

Death or serious irreversible injuries may result.



CAUTION!

Slight reversible injuries may result.



NOTICE!

Property damage is to be expected or may result.



Important note

Non-compliance can result in malfunction or interference



Information

Supplementary note



Request for action



Reaction, result



"see"

abc

Cross-reference

123

Decimal number

0x123

Hexadecimal number

0b010

Binary number

[...]

Designation of pushbuttons, buttons or indications

1.4 Modification history

34492

Version	Topic	Date
00	New creation of document	11 / 2018
01	Correction: Technical data - Max. current load per output	09 / 2019

2 Safety instructions

Content

General.....	7
Required background knowledge.....	7
Safety symbols on the device.....	7
Tampering with the unit.....	7

28333

2.1 General

33834



The plant manufacturer is responsible for the safety of the plant in which the device is installed.

If the device is used in a way that is not intended by the manufacturer, the protection supported by the device may be impaired.

Non-observance of the instructions, operation which is not in accordance with use as prescribed below, wrong installation or incorrect handling can affect the safety of operators and machinery.

- ▶ Observe these operating instructions.
- ▶ Adhere to the warning notes on the product.

2.2 Required background knowledge

34185

This document is intended for specialists. Specialists are people who, based on their relevant training and experience, are capable of identifying risks and avoiding potential hazards that may be caused during operation or maintenance of the product.

The document contains information about the correct handling of the product.

2.3 Safety symbols on the device

34199



General warning

Observe instructions in chapter "Electrical connection" (→ **Electrical connection** (→ S. [13](#)))!

2.4 Tampering with the unit

33190



WARNING!

Tampering with the unit.

- > In case of non-compliance:
 - Possible affects on safety of operators and machinery
 - Expiration of liability and warranty
- ▶ Do not open the devices!
- ▶ Do not insert any objects into the devices!
- ▶ Prevent metal foreign bodies from penetrating!

3 Intended use

Content

Permitted use	8
Prohibited use.....	8

34079

3.1 Permitted use

34211

The IO-Link master serves as a gateway between intelligent IO-Link devices and the PROFINET network. The device is designed for use without a control cabinet in the food industry.

3.2 Prohibited use

34228

The device may not be used beyond the limits of the technical data (→ **Technical data** (→ S. [45](#)))!

4 Function

Content

Communication, parameter setting, evaluation	10
Digital inputs	11
IO-Link supply.....	11

33836

4.1 Communication, parameter setting, evaluation

Content

IO-Link	10
PROFINET	10
Parameter setting	10
Visual indication	10

33860

4.1.1 IO-Link

34084

The device offers the following IO-Link functions:

- IO-Link master (IO-Link revision 1.0 and 1.1)
- 8 IO-Link ports for connection of IO-Link devices
- Provision of process data of the connected IO-Link devices for LR SMARTOBSERVER monitoring software (→ www.ifm.com)

4.1.2 PROFINET

52555

The device offers the following PROFINET functions:

- Profinet RT Device (Class B)
- 2 port switch for access to the PROFINET interface; integrated switch is RT and IRT conform according to PROFINET V2.3
- Gateway for transmission of the process and parameter data between the connected IO-Link devices and the higher-level PROFINET controller
- Supported protocols: SNMP, LLDP, MRP, DCP, RTA, RTC Class 1 (nicht synchronisiert)
- PROFINET features: FSU, I&M0 - 4 read/write
- Device description: GSDML file

4.1.3 Parameter setting

34583

The device provides the following configuration options:

- Parameter setting of the IO-Link master of the AL1103 with parameter setting software LR DEVICE and/or PROFINET projection software
- Parameter setting of the connected IO-Link devices (sensors, actuators) with parameter setting software LR DEVICE and/or PROFINET projection software
- Storage of parameter sets of the connected IO-Link devices for automatic recovery (data storage)

4.1.4 Visual indication

34192

The device has the following visual indicators:

- Status and error indication of the gateway, of the PROFINET connection and of the system
- Status display of the voltage supply
- Status and activity display of the Ethernet connection
- Status, error and short circuit/overload indication of the IO-Link ports

4.2 Digital inputs

33817

The device has 8 additional digital inputs (type 2 according to EN 61131-2).

The digital inputs are on pin 2 of the IO-Link ports X01...X08.

All inputs refer to the potential of the device supply (pin 3).

4.3 IO-Link supply

34077

The device has 8 supplies for IO-Link devices.

The IO-Link ports X01...X08 are ports class A.

Every supply provides short circuit monitoring.

The device ensures fire protection for the connected IO-Link devices by providing a power-restricted circuit at the IO-Link ports (according to IEC61010-1 and Class 2 according to UL1310).

5 Mounting

Content

Mount the device	12
------------------------	----

34058

5.1 Mount the device

34059



- ▶ Disconnect the system from power before installation.
 - ▶ For installation choose a flat mounting surface.
 - ▶ Please observe the maximum tightening torque.
-
- ▶ Fix the unit to the mounting surface using 2 M5 mounting screws and washers.
 - Tightening torque: 1.8 Nm
 - ▶ Ground the unit via the two mounting screws of the upper mounting lugs.

6 Electrical connection

Content

Notes	13
Ethernet ports	14
IO-Link ports	15
Connect the device.....	16

33805

6.1 Notes

51957



A qualified electrician must connect the unit.

- ▶ The national and international regulations setting up electrical equipment must be complied with.

The unit is only suitable for operation using SELV/PELV voltages.

- ▶ Please note the information concerning IO-Link wiring!

This unit contains components that may be damaged or destroyed by electrostatic discharge (ESD).

- ▶ Please observe the required precautions against electrostatic discharge!

The IP rating of the overall system depends on the protection ratings of the individual devices, the applied connection elements and the corresponding protective caps.

- ▶ Provide cables with a strain relief depending on the mounting conditions to avoid excessive strain on the installation points and the M12 connections.
- ▶ Ensure correct fit and proper assembly of the M12 connecting parts. If these instructions are not complied with, the specified protection rating cannot be guaranteed.

For UL applications:

- ▶ To connect the IO-Link master and the IO-Link devices, only use UL-certified cables of the CYJV or PVVA category with a minimum temperature of 80 °C (75 °C in case of maximum ambient temperature of 40 °C).


Wiring: → **Technical data** (→ S. [45](#))

By means of basic insulation according to EN61010-1, the circuits are separated from each other and from device surfaces that could be touched (secondary circuit with 28 V DC maximum, supplied from mains circuit up to 300 V overvoltage category II).

By means of basic insulation according to EN61010-1, the communication interfaces are separated from each other and from device surfaces that could be touched (secondary circuit with 28 V DC maximum, supplied from mains circuit up to 300 V overvoltage category II). They are designed for network environment 0 according to IEC TR62102.

6.2 Ethernet ports

34576

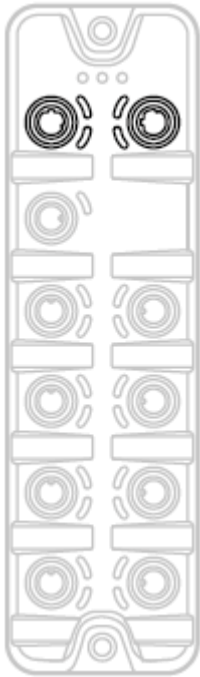

- ▶ Connect the unit via the M12 socket X21 and/or X22 with the PROFINET network (e.g. PROFINET PLC, additional PROFINET device)
 - Tightening torque: 0.6...0.8 Nm
- ▶ Connect the unit via the M12 socket X21 and/or X22 to the industrial Ethernet network (e.g. laptop/PC with installed parameter setting software LR DEVICE, laptop/PC with installed monitoring software LR SMARTOBSERVER)
 - Tightening torque: 0.6...0.8 Nm
- ▶ For the connection, use M12 connectors with protection rating IP 65 / IP 66 / IP 67 / IP 69K or higher (→ **Accessories** (→ S. 43)).
- ▶ Cover the unused sockets with M12 protective caps (art no. E12542).
 - Tightening torque 0.6...0.8 Nm

6.3 IO-Link ports

51958

The IO-Link ports of the AL1103 meet the requirements of the IO-Link specifications 1.0 to 1.1.2.

- ▶ Please note the information concerning IO-Link wiring!
- ▶ Cover unused sockets with M12 protective caps (art. no.: E12542).
 - Tightening torque 0.6...0.8 Nm

6.3.1 Connect IO-Link devices for Class A operation

51959

Wiring information:

- The connected IO-Link devices must be supplied exclusively via the IO-Link master.
- The additional digital inputs IO-Link ports X01...X08 (pin 2) have a type 2 behaviour according to the standard EN61131-2. The connected electronics must be electrically suited for this.



- ▶ Connect the connectors of the IO-Link devices with the M12 sockets of the IO-Link ports X01...X08.
 - Tightening torque: 0.6...0.8 Nm
 - Maximum cable length per IO-Link port: 20 m
- ▶ To connect the devices, use M12 connectors with protection rating IP 65 / IP 66 / IP 67 / IP 69K or higher (→ **Accessories** (→ S. [43](#))).

6.4 Connect the device

33882



- ▶ Disconnect power.
- ▶ Connect the IO-Link Master via M12 socket X31 to 24 V DC (20...28 V SELV/PELV; according to EN61010-1, secondary circuit with maximum 30 V DC supplied by mains circuit up to 300 V of overvoltage category II).
 - Tightening torque: 0.6...0.8 Nm
 - Maximum cable length: 25 m
- ▶ To connect the device, use M12 connectors with protection rating IP 65 / IP 66 / IP 67 / IP 69K or higher (→ **Accessories** (→ S. [43](#))).



When using cable length greater than 25 m keep in mind the voltage drop as well as the required minimum voltage supply of 20 V!

7 Operating and display elements


Content

Overview.....	17
LED indicators	18

34063

7.1 Overview

34612

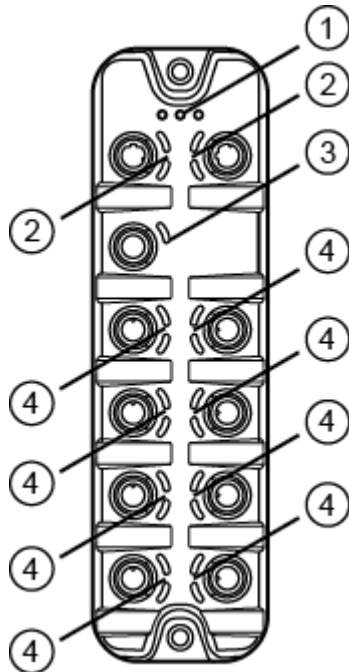

- ① Status LEDs RDY, BF and SF
→ **Status LEDs** (→ S. [18](#))
- ② Status LEDs LNK and ACT of the PROFINET ports 1 (X21) and 2 (X22)
→ **Ethernet interface** (→ S. [18](#))
- ③ Status LED US of the power supply (X31)
→ **Voltage supply** (→ S. [19](#))
- ④ Status LEDs IOL and DI of the IO-Link ports Class A (X01...X08)
→ **IO-Link ports (Class A)** (→ S. [19](#))

7.2 LED indicators

34047

The device only has the following LED indicators:

7.2.1 Status LEDs

34549

The RDY LED shows the status of the gateway.

The BF LED (Bus Failure) shows the status of the PROFINET connection.

The SF LED (System Failure) shows the status of the system.

Status LED			Description
RDY	green	on	Gateway functions properly
		flashes 1 Hz	Error
		flashes 5 Hz	Firmware update
		off	Gateway does not function; Unit reboots
BF	red	on	Bus error
		flashes 1 Hz	No connection to the PROFINET controller
		off	error-free
SF	red	on	<ul style="list-style-type: none"> ▪ Error in gateway ▪ At least 1 IO-Link device sends warning / alarm (temperature, over/under current, over/under voltage, shortcut)
		off	error-free

7.2.2 Ethernet interface

34348

Each Ethernet interface (X21, X22) has 2 LEDs (LNK and ACT). The LEDs indicate the status of the Ethernet connection.

Status LED			Description
LNK	green	on	Ethernet connection established
		off	No Ethernet connection
ACT	yellow	flashes	Data is transmitted via the Ethernet interface.
		off	No data transmission

7.2.3 Voltage supply

34191

The interface for voltage supply (X31) has the LED that is marked as US. The LED indicates the status of the voltage supply.

Status LED			Description
US	green	on	The supply voltage U_s is applied.
		off	No supply voltage is applied or the applied supply voltage is too low.

7.2.4 IO-Link ports (Class A)

34074

Each IO-Link port Class A has 2 LEDs marked as IOL and DI. The LEDs indicate the status of the IO-Link port.

Status LED			Description
IOL	yellow	off	Port configured as DI / DO: pin 4 (C/Q) = OFF
		on	Port configured as DI / DO: pin 4 (C/Q) =ON
	green	flashes 1 Hz	Port configured as IO-Link: no IO-Link device detected
		flashes 2 Hz	Port configured as IO-Link: PROOPERATE state
		on	Port configured as IO-Link: OPERATE state
	red	flashes 2 Hz	Port configuration error or short circuit or overload
		on	Transmission error
DI	yellow	off	Digital input : pin 2 (DI) = OFF
		on	Digital input: pin 2 (DI) = ON

8 Set-up

Content

Read device and diagnostic information	21
--	----

52476

When the supply voltage has been switched on, the AL1103 starts with the factory settings. The display elements signal the current operating status (→ **Operating and display elements** (→ S. [17](#))).

To enable parameter setting of the AL1103, the fieldbusinterface of the network environment must be configured correspondingly.

- ▶ Configure the fieldbus interface (ports X21 / X22) (→ **Fieldbus: Set PROFINET interface** (→ S. [26](#)) or → **Integrate the IO-Link master in the project** (→ S. [33](#))).
- > The fieldbus interface has valid IP settings.
- > The user can set the parameters of the AL1103.

Further steps:

- Optional: Update the firmware of the AL1103 (→ **Firmware update** (→ S. [40](#))).
- Set the parameters of the AL1103 (→ **Configuration** (→ S. [22](#))).

8.1 Read device and diagnostic information

In order to read the diagnostic information about the current device status via the web interface:

- ▶ Connect laptop/PC and AL1103 via the Ethernet internet.
- ▶ Start web browser.
- ▶ Enter the IP address of the AL1103 into the address field of the browser and press [ENTER] to confirm.
- > Web browser shows the web interface of the device.
- > The page shows the following data:
 - Table with connected IO-Link devices

Name	Description
[Port]	Number of the IO-Link interface
[Mode]	Operating mode of the IO-Link interface
[Comm. Mode]	Baud rate of the IO-Link interface
[MasterCycleTime]	Cycle time
[Vendor ID]	ID of the manufacturer of the IO-Link device
[Device ID]	ID of the IO-Link device
[Name]	Article number of the IO-Link device <ul style="list-style-type: none"> ▪ For ifm articles: This article number is stored along with a link to the produkt page on the ifm website.
[Serial]	Serial number of the IO-Link device
[LR Mode / Interval]	Cycle time for the communication with the SmartObserver

- Diagnostic information of the device

Name	Description
[SW-Version]	
[Current]	Current (in mA)
[Voltage]	Voltage (in mV)
[Short Circuit]	Number of detected short circuits
[Overload]	Number of detected overloads
[Undervoltage]	Number of detected under voltages
[Temperature]	Device temperature (in °C)

- Version information of the installed firmware components

Name	Description
[Firmware]	Firmware version
[Container]	Version of the firmware container
[Bootloader Version]	Version of the boot loader
[Fieldbus Firmware]	Version of the PROFINET firmware

9 Configuration

Content

LR DEVICE.....	23
PROFINET.....	32

33858

9.1 LR DEVICE

Content

Remarks	24
IoT: Configure access rights	25
IoT: Configure the interface to the LR SMARTOBSERVER	26
Fieldbus: Set PROFINET interface	26
IO-Link ports: Activate data transfer to the LR SMARTOBSERVER	27
IO-Link ports: Configure operating mode	28
IO-Link ports: Set the device validation and data storage	29
Firmware: Reset device to factory settings	30
Firmware: Reboot the device	30
Configure IO-Link devices	31

33692

On delivery, the AL1103 is configured with the factory settings (→ **Factory settings** (→ S. [42](#))).

Required software: LR DEVICE (1.4.0.x or higher) (art.-no.: QA0011/QA0012)

9.1.1 Remarks

Content

Offline parameter setting	24
VPN connection	24

34180

Offline parameter setting

34060

The AL1103 supports the offline parameter setting. In this context, the user creates and stores a configuration for the IO-Link master and the connected IO-Link devices without being connected to the AL1103 (OFFLINE mode). The configuration created in this way can be stored as a file (*.lrp) and loaded to the AL1103 and activated at a later date.



Further information about offline parameter setting: → Operating instructions LR DEVICE

VPN connection

34382



An active VPN connection blocks the access of the parameter setting software LR DEVICE to the PROFINET interface of the AL1103.

- ▶ Deactivate the VPN connection in order to be able to access the AL1103 with the LR DEVICE.

9.1.2 IoT: Configure access rights

The access rights define which instance may read and / or write the parameter data, process data and event/diagnostic messages.

In order to configure the access rights to the IO-Link master:

- ▶ Select [IoT] menu.
- > The menu page shows the current settings.
- ▶ Set the following parameters as required:

Name	Description	Possible values
[Access Rights]	The access rights to the parameter data, process data and the event/diagnostic messages of the IO-Link master as well as the connected IO-Link devices	[PROFINET + IoT] <ul style="list-style-type: none"> ▪ PROFINET and IoT Core have read and write access rights to parameters and process data ▪ PROFINET and <IoT Core> have read access rights to events/alarms
		[PROFINET + IoT (read-only)] <ul style="list-style-type: none"> ▪ PROFINET has read and write access rights to parameters and process data ▪ PROFINET has read access rights to events/alarms ▪ IoT Core only has read access rights to parameters, process data and events/alarms
		[IoT only] <ul style="list-style-type: none"> ▪ IoT Core has read and write access rights to parameters and process data ▪ IoT has read access rights to events/alarms ▪ PROFINET has no access rights

- ▶ Save changed values on the device.



If the parameter [Access rights] is set to [PROFINET + IoT] via IoT and PROFINET projection, then the parameter values set in the PROFINET projection software apply.

If the parameter [Access rights] is set to [IoT only] via IoT, then set the parameter [Access rights] to [Keep settings] in the PROFINET projection software.

Changes of the parameter [Access Rights] are only effective after restarting the device (→ **Firmware: Reboot the device** (→ S. [30](#)))

9.1.3 IoT: Configure the interface to the LR SMARTOBSERVER

34048

To enable data transfer between the device and the LR SMARTOBSERVER monitoring software, the LR SMARTOBSERVER monitoring software interface has to be configured.

- ▶ Select [IoT] menu.
- > The menu page shows the current settings.
- ▶ Set the following parameters as required:

Name	Description	Possible values	
[IP address LR SMARTOBSERVER]	IP address of the PC on which the LR SMARTOBSERVER is installed.	Factory setting: 255.255.255.255	
[Port LR SMARTOBSERVER]	Port number that is used to send process data to the LR SMARTOBSERVER	0 ... 65535	Factory setting:: 35100
[Interval LR SMARTOBSERVER]	Cycle time for the transfer of the process data to the LR SMARTOBSERVER (value in milliseconds)	[Off]	no transfer
		500 ... 2147483647	500 ms ... 2147483647 ms
[Application Tag]	Source identifier of the IO-Link master in the structure of the LR SMARTOBSERVER (String32)	Factory setting: AL1103	



After changing the parameter [Port LR SMARTOBSERVER] or [Application Tag], it may take 120 seconds before the device establishes a new TCP connection.

To prevent the delay:

- ▶ Reboot the device after the parameter change.
- ▶ Save changed values on the device.

9.1.4 Fieldbus: Set PROFINET interface

34589

For the access of the PROFINET interface the Ethernet ports X21/X22 need to be set:

- ▶ Select [Fieldbus] menu.
- > The menu page shows the current settings.
- ▶ Set the following parameters as required:

Name	Description	Possible values
[IP address]	IP address of the PROFINET interface	Factory setting: 0.0.0.0
[Subnet mask]	Subnet mask of the IP network	Factory setting: 0.0.0.0
[Default gateway IP address]	IP address of the network gateway	Factory setting: 0.0.0.0
[MAC address]	MAC address of the PROFINETA interface	The value is firmly set.
[Fieldbus firmware]		

- ▶ Save changed values on the device.

9.1.5 IO-Link ports: Activate data transfer to the LR SMARTOBSERVER

33690

The user can decide separately for each IO-Link port if the process data of the connected IO-Link devices should be transferred to the LR SMARTOBSERVER.



To transfer process data the interfaces to the LR SMARTOBSERVER have to be correctly configured (→ **IoT: Configure the interface to the LR SMARTOBSERVER** (→ S. [26](#))).

To activate / deactivate data transfer:

- ▶ Select [Port x] menu (x = 1...8).
- > The menu page shows the current settings.
- ▶ Set the following parameters as required:

Name	Description	Possible values	
[Transmission to LR SMARTOBSERVER]	Transfer of process data of the connected IO-Link device to LR SMARTOBSERVER	[Disabled]	Process data is not transferred
		[Enabled]	Process data is transferred

- ▶ Save changed values on the device.

9.1.6 IO-Link ports: Configure operating mode

The IO-Link ports X01...X08 of the device support the following operating modes:

- Digital input (DI): binary input signal at pin 4 (C/Q) of the IO-Link port
- Digital output (DO): binary output signal at pin 4 (C/Q) of the IO-Link port
- IO-Link: IO-Link data transfer via pin 4 (C/Q) of the IO-Link port

The user can set the operating mode separately for each IO-Link port.

To set the operating mode of an IO-Link port:

- ▶ Select [Port x] menu (x = 1...8).
- > The menu page shows the current settings.
- ▶ Set the following parameters as required:

Name	Description	Possible values	
[Mode]	Operating mode of the IO-Link port	[Disabled]	Port deactivated
		[DI]	Operation as digital input
		[DO]	Operation as digital output
		[IO-Link]	Operation as IO-Link interface
[Cycle time actual]**	Current cycle time of the data transfer between IO-Link master and IO-Link device on the port (value in microseconds)	Parameter can only be read	
[Cycle time preset]*	Cycle time of the data transfer between the IO-Link master and the IO-Link device at the port (value in microseconds)	0	The device automatically sets the fastest possible cycle time.
		1	1 microsecond
	
		132800	132800 microseconds
[Bitrate]**	Current transmission rate of the data transfer between the IO-Link master and the IO-Link device on the port	Parameter can only be read	

* ... Parameter only available if [Mode] = [IO-Link]

** ... Parameter only visible if the IO-Link device is connected to the IO-Link port.

- ▶ Save changed values on the device.

9.1.7 IO-Link ports: Set the device validation and data storage

In the operating mode "IO-Link" the user can set the behaviour of the IO-Link port with regard to device validation and the storage / restoration of the parameter data of the connected IO-Link device.

To configure the device validation and the data storage:

- ▶ Select [Port x] menu (x = 1...8).
- > The menu page shows the current settings.
- ▶ Set the following parameters as required:

Name	Description	Possible values	
[Validation / Data Storage]	Supported IO-Link standard and behaviour of the device during connection of a new IO-Link device on port x (x = 1...8)	[No check and clear]	<ul style="list-style-type: none"> ▪ No verification of the vendor ID and device ID ▪ No data storage
		[Type compatible V1.0 device]	<ul style="list-style-type: none"> ▪ IO-Link device is compatible with the V1.0 IO-Link standard ▪ Verification whether it is an IO-Link device of the same type (validation via vendor ID and device ID) ▪ No data storage
		[Type compatible V1.1 device]	<ul style="list-style-type: none"> ▪ IO-Link device is compatible with the V1.1 IO-Link standard ▪ Verification whether it is an IO-Link device of the same type (validation via vendor ID and device ID) ▪ No data storage
		[Type compatible V1.1 device with Backup + Restore]	<ul style="list-style-type: none"> ▪ IO-Link device is compatible with the V1.1 IO-Link standard ▪ Verification whether it is an IO-Link device of the same type (validation via vendor ID and device ID) ▪ The IO-Link master saves the parameter values of the connected IO-Link device; modifications of the parameter values are also saved (observe the note!) ▪ When connecting an IO-Link device with factory settings, the parameter values stored in the IO-Link master are restored automatically on the IO-Link device.
		[Type compatible V1.1 device with Restore]	<ul style="list-style-type: none"> ▪ IO-Link device is compatible with the V1.1 IO-Link standard ▪ Verification whether it is an IO-Link device of the same type (validation via vendor ID and device ID) ▪ The IO-Link master saves the parameter values of the connected IO-Link device once. ▪ When connecting an IO-Link device with factory settings, the parameter values stored in the IO-Link master are restored automatically on the IO-Link device.
[Vendor ID]	ID of the manufacturer that is to be validated	0 ... 65535	Factory setting: 0 ifm electronic: 310
[Device ID]	ID of the IO-Link device that is to be validated	0 ... 16777215	Factory setting: 0

- ▶ Save changed values on the device.

9.1.8 Firmware: Reset device to factory settings

33838

When the IO-Link master is reset, all parameters are set to the factory settings:

To reset the device to factory settings:

- ▶ Select [Firmware] menu.
- > The menu page shows the current settings.
- ▶ Click on [Factory Reset] to reset the device.
- > LR DEVICE sets the device to the factory settings.

9.1.9 Firmware: Reboot the device

33832

When rebooting the device, all settings are kept.

To restart the AL1103:

- ▶ Select [Firmware] menu.
- > The menu page shows the current settings.
- ▶ Click on [Reboot] to reboot the device.
- > LR DEVICE reboots the ifm IO-Link master.

9.1.10 Configure IO-Link devices

To configure the IO-Link devices connected to the device with the LR DEVICE parameter setting software:

Requirements:


- > IO-Link master is correctly installed and connected to the LR DEVICE parameter setting software.
- > The IO-Link device is correctly connected to the AL1103.
- > Operating mode of the IO-Link port is "IO-Link" (→ **IO-Link ports: Configure operating mode** (→ S. 28)).
- > IoT has write access rights to the IO-Link master (→ **IoT: Configure access rights** (→ S. 25)).

1 Select IO-Link master

- ▶ Start LR DEVICE.
- ▶ Update IODD file library
OR:
Import IODD file of the IO-Link device manually.
- ▶ Scan network for devices.
- > LR DEVICE detects IO-Link master.

2 Add IO-Link device

- ▶ Under [ONLINE]: Click on the required IO-Link master.
- > LR DEVICE automatically detects the IO-Link devices connected to the IO-Link master (e.g. ifm sensor KG5065).

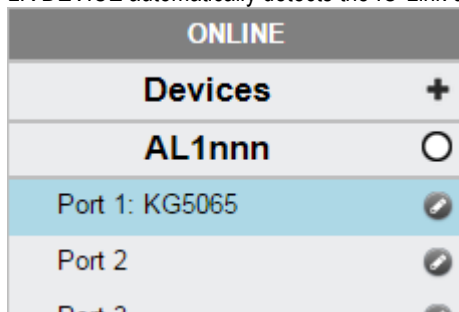

3 Configure IO-Link device

- ▶ Mouse click on the port to which the IO-Link device is connected.
- > LR DEVICE reads and shows the current parameter values of the IO-Link device.
- ▶ Configure IO-Link device.



Information about the available parameters of the IO-Link device: → IO Device Description (IODD) of the IO-Link device

- ▶ Save the changed configuration on the IO-Link device.

9.2 PROFINET

Content

Install GSD Files	33
Integrate the IO-Link master in the project	33
Configure the IO-Link master	34
Configure IO-Link ports	35
Configure IO-Link devices	36
Read and write cyclic process data	37
Read I&M datasets	38
Detect diagnostics and alarms	38

34541

On the field bus side, the device can be configured with the following options:

- PROFINET projection software STEP 7 (version 5.5 SP 4 or higher)
- PROFINET projection software TIA portal



Further information about operation and functions of the PROFINET parameter setting software:

- ▶ Use the help function of the PROFINET projection software!

9.2.1 Install GSD Files

52478


ifm provides a GSD file to integrate the AL1103 in the PROFINET projection software. All parameters, process data and their valid value ranges are defined in the GSD file. The user can download the GSD file from the ifm website (→ www.ifm.com)).

To add the IO-Link master to the hardware catalogue of the PROFINET projection software:

- ▶ Download the GSD file of the AL1103 from the ifm website.
- ▶ Launch the PROFINET projection software.
- ▶ Install the GSD file of the AL1103.

Once the GSD file is installed, the AL1103 is in the hardware catalogue in the following folder:

> [PROFINET IO] > [Additional Field Devices] > [IO] > [ifm electronic]

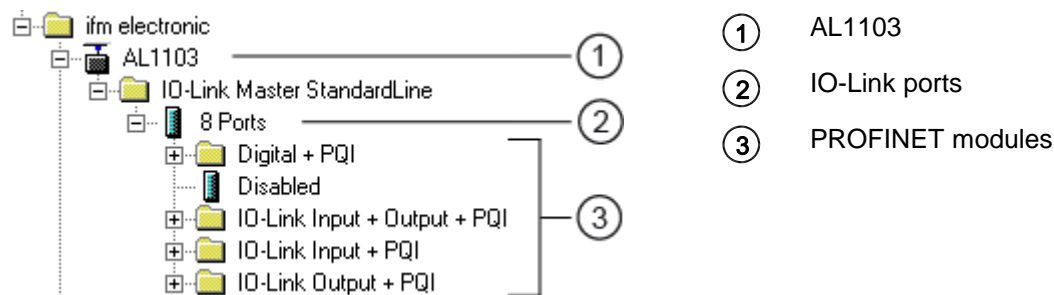

9.2.2 Integrate the IO-Link master in the project

52479

The AL1103 can be integrated from the hardware catalogue into the project.

- ▶ Create new project /open project
 - ▶ Create and configure PROFINET controller and coupling units.
 - ▶ Create and configure PROFINET connection.
 - ▶ Drag the [AL1103] node from the hardware catalogue and drop it on the PROFINET connection.
- > The AL1103 is displayed as part of the PROFINET network.

To integrate the AL1103 in the network infrastructure, the fieldbus interface must be configured correspondingly.

- ▶ Double click on slot 0 to open the configuration of the AL1103.
- ▶ Configure the Ethernet interface of the IO-Link master.
- ▶ Drag the [8 Ports] node from the hardware catalogue and drop it on slot 1 of the IO-Link master.
- ▶ Save the project.

The IO-Link master is integrated in the project and can be configured.

9.2.3 Configure the IO-Link master

52480

You can access the configuration of the IO-Link master via slot 1.1 of the AL1103.

The parameter [Access Rights] determines which controller instance may have read and write access to the data of the IO-Link master.

To set the parameters of the IO-Link master:

- ▶ In the project: Double click on slot 1.1 of the AL1103.
- ▶ Set parameters [Access Rights] as required (→ **Parameter of the IO-Link master** (→ S. [49](#))).
- ▶ Save the project.



If the parameter [Access Rights] = [PROFINET + IoT] in LR DEVICE and the PROFINET projection software, the parameter values set in the PROFINET projection software will always apply.

If the parameter [Access Rights] = [IoT only] in LR DEVICE, set the parameter [Access Rights] = [Keep settings] in the projection software.

Changes of the parameter [Access Rights] will only be effective after restarting the IO-Link master (→ **Firmware: Reboot the device** (→ S. [30](#))).

9.2.4 Configure IO-Link ports

52481

You can access the configuration of the IO-Link ports via the slots 1.2 ... 1.9 of the AL1103. The following assignment applies

Slot	IO-Link port of the AL1103
1.2	Port X01
1.3	Port X02
...	...
1.9	Port X08

The available PROFINET modules are defined in the GSD file (→ **PROFINET modules** (→ S. 52)). A PROFINET module determines the following properties of an IO-Link port:

- Operating mode (IO-Link, DI, DO, deactivated)
- Type and length of the process data
- optional data (fail-safe values, device validation, data storage, cycle time, events)

The following table shows the available parameters depending on the selected operating mode:

Operating mode of the IO-Link ports	Available parameters						
	Fail-safe mode	Pattern Value	Validation / Data storage	Vendor ID (VID)	Device ID	Port cycle time	IO-Link events
DI: digital input	--	--	--	--	--	--	X
DO: digital output	X	--	--	--	--	--	X
IO-Link: input	--	--	X	X	X	X	X
IO-Link: output	X	X	X	X	X	X	X
IO-Link: input and output	X	X	X	X	X	X	X

-- = not available

X = available

To configure an IO-Link port of the AL1103:

- ▶ Drag the required PROFINET module from the hardware catalogue and drop it on the slot of the IO-Link port.
- ▶ Double click on the slot of the IO-Link port
- ▶ Set the parameters as required (→ **Parameters of the IO-Link ports** (→ S. 50)).
- ▶ Repeat the steps to configure further IO-Link ports.
- ▶ Save the project.

9.2.5 Configure IO-Link devices

52482

The AL1103 supports the configuration of the connected IO-Link devices via the PROFINET application. The configurable parameters depend on the IO-Link device that is used.



Configurable parameters of the IO-Link devices: → IO Device Description (IODD) of the IO-Link Devices

The following options are available:

Symbol (function block)	Description	Notes
IO_LINK_DEVICE (FB5001)	Acyclic access to the parameters of an IO-Link device	Input parameter: <ul style="list-style-type: none"> ▪ CAP: Access point for function AL1103: AL1103: 0xB400 ▪ PORT: Slot/sub-slot of the IO-Link interface of the connected IO-Link device Port X01: 1 Port X02: 2 ... Port X08: 8 ▪ IOL_INDEX and IOL_SUBINDEX: Index and sub-index of the parameter (depends on the IO-Link device: → IO Device Description (IODD))
IOL_CALL (FB1)	Acyclic access to the parameters of an IO-Link devices (obsolete)	→ IO_LINK_DEVICE (FB5001)

9.2.6 Read and write cyclic process data

52483

While the IO-Link ports are being configured, IEC addresses are generated automatically for inputs and outputs as well as the PQI byte. To enable access to the cyclic process data in the application, the user must couple the IEC addresses with symbolic variables. This can be done in global lists of variables (STEP 7: [Symbols]; TIA portal: [PLC tags]).

Take the following actions in global lists of variables of the PROFINET controller:

- ▶ Create a symbolic name and select the data type
- ▶ Assign an IEC address to the symbolic name
- ▶ Save the project.

Using the symbolic name, the user can read the inputs and write the outputs from the application.



- ▶ To check the validity of the cyclic process data, evaluate the PQI byte (→ **PQI (Port Qualifier Information)** (→ S. [53](#))).

Even if the fieldbus connection is interrupted, the PQI byte indicates that the process data is valid. This may have an unintended impact on the control process.

- ▶ Take suitable measures to detect an interruption of the fieldbus connection.

Read additional digital input

52549

IO-Link ports X01...X08 have a additional digital input (pin 2). The current value is mapped to the PQI byte (→ **PQI (Port Qualifier Information)** (→ S. [53](#))).

9.2.7 Read I&M datasets

52484

I&M0 provide the user with device-specific basic information. This ensures reliable identification of the device, the device's hardware and software components as well as the manufacturer.

The datasets I&M1 to 3 offer the programmer the possibility to store project-specific information on the device.

The programmer can access the I&M0 datasets of the slots 0 and 1 in the PROFINET projection software by means of the following functions:

Symbol / function block	Description	Notes
GET_IM_DATA	<ul style="list-style-type: none"> ▪ Function block for reading the I&M datasets of a device ▪ GET_IM_DATA only supports the reading of the I&M0 dataset 	Input parameters: <ul style="list-style-type: none"> ▪ IM_TYPE = 0
RDREC	Function block for acyclic reading of datasets	Input parameters: <ul style="list-style-type: none"> ▪ I&M0: Index = 0xAFF0 ▪ I&M1: Index = 0xAFF1 ▪ I&M2: Index = 0xAFF2 ▪ I&M3: Index = 0xAFF3
WRREC	<ul style="list-style-type: none"> ▪ Function block for acyclic writing of datasets ▪ Observe access rights on datasets! 	Input parameters: <ul style="list-style-type: none"> ▪ I&M1: Index = 0xAFF1 ▪ I&M2: Index = 0xAFF2 ▪ I&M3: Index = 0xAFF3

9.2.8 Detect diagnostics and alarms

52485



Available alarms and diagnostic messages: → **Diagnostic and alarms** (→ S. [56](#))

Symbol	Operational block	Description
I/O_FLT1	OB82	Diagnostic alarms
I/O_FLT2	OB83	Connect/disconnect alarms
RACK_FLT	OB86	Module rack failure

10 Maintenance, repair and disposal

Content

Cleaning process	39
Firmware update.....	40
Replace IO-Link device	41

51990

The operation of the unit is maintenance-free.

- ▶ Dispose of the unit in an environmentally friendly way in accordance with the applicable national regulations when it is no longer used.

10.1 Cleaning process

51991

- ▶ Clean the surface of the unit when necessary.
- ▶ Do not use any caustic cleaning agents for this!

10.2 Firmware update

33826

The new firmware is installed via the device's web interface.



If the firmware update is not successful, deactivate all connections to the PROFINET PLC, LR SMARTOBSERVER and LR DEVICE and repeat the process.

- ▶ Close connection to PROFINET PLC.
- ▶ Set the parameter [IP address SmartObserver] to 255.255.255.255 or 0.0.0.0 (→ **IoT: Configure the interface to the LR SMARTOBSERVER** (→ S. [26](#))).
- ▶ Stop the LRAgent.LRDevice service in the Windows task manager.

After the firmware update check the settings of the LR SMARTOBSERVER interface!

To install a new firmware version on the device:

Requirements

- > File with new firmware has been downloaded.
- > Ethernet connection between laptop/PC and device is established.

1 Call up web interface

- ▶ Start web browser.
- ▶ Enter the following into the address field of the browser and press [ENTER] to confirm:
`http://<IP address of the device>/web/update`
- > Web browser shows the [Firmware Update] page.

2 Load new firmware to AL1103

- ▶ Click on [Select file].
- > Dialogue window appears.
- ▶ Select the firmware file and click on [Open] in order to adopt the file.
- ▶ Click on [Submit] to start the firmware update.
- > Firmware is being loaded to the device.
- > After successful storage, the success message is displayed

3 Restart the device

- ▶ Click on [Restart device now] to restart the device.
- > The status LED RDY flashes quickly.
- > Firmware is updating.
- ▶ Follow the instructions in the browser.

10.3 Replace IO-Link device

34182

To replace an IO-Link device:

Requirement:

- > IO-Link device is with factory settings.
- > IO-Link device supports IO-Link standard 1.1 or higher.

1 Set data storage

- ▶ Set the following parameters of the IO-Link port:
Validation and Data Storage = [Type compatible V1.1 device with Restore]
- ▶ Save changes.

2 Replace IO-Link device

- ▶ Disconnect old IO-Link device from IO-Link master.
- ▶ Connect new IO-Link device with the same IO-Link port of the AL1103.
- > IO-Link master copies parameter values from the data memory to the new IO-Link device.

11 Factory settings

34594

In the factory settings, the device has the following parameter settings:

Parameters	Factory setting
[IP address]	0.0.0.0
[Subnet mask]	0.0.0.0
[IP gateway address]	0.0.0.0
[PROFINET name]	blank
Data Storage	empty

12 Accessories

33870

List of accessories of AL1103: → www.ifm.com > Product page > Accessories

13 Appendix

Content

Technical data	45
PROFINET	49

33879

13.1 Technical data

Content

Application	45
Electrical data	45
Inputs / outputs	45
Inputs	46
Outputs	46
Interfaces	46
Operating conditions	47
Approvals / tests	47
Mechanical data	47
Electrical connection	48

34188

13.1.1 Application

33878

Application	
Application	I/O modules for field applications
Daisy-chain function	Communication interface

13.1.2 Electrical data

33808

Electrical data	
Operating voltage [V]	20...28 DC; (US; to SELV/PELV)
Current Consumption [mA]	300...3900; (US)
Protection class	III
Sensor supply US	
Max. current load total [A]	3.6

13.1.3 Inputs / outputs

34068

Inputs / outputs	
Total number of inputs and outputs	16; (configurable)
Number of Inputs and Outputs	Number of digital inputs: 16; Number of digital outputs: 8

13.1.4 Inputs

34069

Inputs	
Number of digital inputs	16; (IO-Link Port Class A: 8 x 2)
Switching level high [V]	11...28
Switching level low [V]	0...5
Digital inputs protected against short circuits	yes

13.1.5 Outputs

34053

Outputs	
Number of digital outputs	8; (IO-Link Port Class A: 8 x 1)
Max. current load per output [mA]	300
Short-circuit protection	yes

13.1.6 Interfaces

34586

Interfaces	
Communication interface	Ethernet; IO-Link
Communication interface	IO-Link; TCP/IP; PROFINET IO
Ethernet	
Transmission standard	10Base-T; 100Base-TX
Transmission rate	10; 100
Protocol	TCP/IP; PROFINET IO
Factory settings	<ul style="list-style-type: none"> ▪ IP address: 0.0.0.0 ▪ Subnet mask: 0.0.0.0 ▪ Gateway IP address: 0.0.0.0 ▪ MAC address: see type label
IO-Link Master	
Transmission type	COM 1 / COM 2 / COM 3
IO-Link revision	V1.1
Number of ports class A	8

13.1.7 Operating conditions

34062

Operating conditions	
Applications	Indoor use
Ambient temperature [°C]	-25...60
Storage temperature [°C]	-25...85
Max. perm. relative air humidity [%]	90
Max. height above sea level [m]	2000
Protection rating	IP 65; IP 66; IP 67; IP 69K; (operation with stainless steel protective caps: IP 69K)
Pollution Degree	2

13.1.8 Approvals / tests

33877




Approval / tests	
EMC	<ul style="list-style-type: none"> ▪ EN 61000-6-2 ▪ EN 61000-6-4
MTTF [Years]	90

13.1.9 Mechanical data

34050

Mechanical data	
Weight [g]	410
Materials	Housing: PA grey; socket: 1.4404 (stainless steel / 316L)

13.1.10 Electrical connection

Voltage supply IN X31											
Connector	M12										
Wiring	 <table style="display: inline-table; vertical-align: middle;"> <tr> <td>1:</td> <td>+ 24 V DC (US)</td> </tr> <tr> <td>2:</td> <td>-</td> </tr> <tr> <td>3:</td> <td>GND (US)</td> </tr> <tr> <td>4:</td> <td>-</td> </tr> </table>	1:	+ 24 V DC (US)	2:	-	3:	GND (US)	4:	-		
1:	+ 24 V DC (US)										
2:	-										
3:	GND (US)										
4:	-										
Ethernet IN / OUT X21, X22											
Connector	M12										
Wiring	 <table style="display: inline-table; vertical-align: middle;"> <tr> <td>1:</td> <td>TX +</td> </tr> <tr> <td>2:</td> <td>RX +</td> </tr> <tr> <td>3:</td> <td>TX -</td> </tr> <tr> <td>4:</td> <td>RX -</td> </tr> <tr> <td>5:</td> <td>-</td> </tr> </table>	1:	TX +	2:	RX +	3:	TX -	4:	RX -	5:	-
1:	TX +										
2:	RX +										
3:	TX -										
4:	RX -										
5:	-										
Process connection IO-Link Ports Class A X01...X0<IOL_AnzPorts>											
Connector	M12										
Wiring	 <table style="display: inline-table; vertical-align: middle;"> <tr> <td>1:</td> <td>+ 24 V DC (US)</td> </tr> <tr> <td>2:</td> <td>DI</td> </tr> <tr> <td>3:</td> <td>GND (US)</td> </tr> <tr> <td>4:</td> <td>C/Q IO-Link</td> </tr> <tr> <td>5:</td> <td>-</td> </tr> </table>	1:	+ 24 V DC (US)	2:	DI	3:	GND (US)	4:	C/Q IO-Link	5:	-
1:	+ 24 V DC (US)										
2:	DI										
3:	GND (US)										
4:	C/Q IO-Link										
5:	-										

13.2 PROFINET

Content

Parameter data	49
Cyclic data	52
Acyclic data	54

33674

13.2.1 Parameter data

34546

Slot	Subslot	Name	Description
1	1	Master	Parameter data of the IO-Link master (→ Parameter of the IO-Link master (→ S. 49))
	2	Port X01	<ul style="list-style-type: none"> ▪ Parameter data of the IO-Link ports (→ Parameters of the IO-Link ports (→ S. 50)) ▪ modules (→ PROFINET modules (→ S. 52))
	3	Port X02	
	4	Port X03	
	5	Port X04	
	6	Port X05	
	7	Port X06	
	8	Port X07	
	9	Port X08	

Parameter of the IO-Link master

34552

Parameter	Description	Possible values	
[Access Rights]	The access rights to the parameter data, process data and events/diagnostic messages of the IO-Link master and the connected IO-Link devices	PROFINET + IoT	<ul style="list-style-type: none"> ▪ PROFINET and LR DEVICE have read and write access rights to parameters and process data ▪ PROFINET and LR DEVICE have read access rights to events/alarms
		PROFINET + IoT (ro)	<ul style="list-style-type: none"> ▪ PROFINET has read and write access rights to parameters and process data ▪ PROFINET has read access rights to events/alarms ▪ LR DEVICE only has read access rights to parameters, process data and events/alarms
		PROFINET only	<ul style="list-style-type: none"> ▪ PROFINET has read and write access rights to parameters and process data ▪ PROFINET has read access rights to events/alarms ▪ LR DEVICE has no access rights (parameters, process data, events/alarms, web interface, firmware update)
		keep setting	keeps settings

Parameters of the IO-Link ports

Parameter	Description	Possible values	
[Fail-safe mode]	Behaviour in case the PROFINET connection is interrupted	No Fail Safe	deactivated
		Fail Safe Reset Value	reset to default values
		Fail Safe Old Value	maintain the most recent valid process value
		Fail Safe with Pattern	set user-defined values
[Pattern Value]*	<ul style="list-style-type: none"> required values for the process data in case the connection is interrupted (as hexadecimal value) Pattern depends on the size of the selected PROFINET module 	Per byte: 0x00 ... 0xFF	
[Port cycle time]	Cycle time of the data transmission at the IO-Link port	as fast as possible	The device automatically sets the fastest possible cycle time
		2.0 ms ... 128.0 ms	2 milliseconds ... 128 milliseconds
[Validation / Data Storage]	Supported IO-Link standard and behaviour of the AL1103 when a new IO-Link device is connected to the IO-Link port	no check and clear	<ul style="list-style-type: none"> no verification of the vendor ID and device ID no data storage
		Type compatible V1.0 device	<ul style="list-style-type: none"> IO-Link device is compatible with the V1.0 IO-Link standard Verification whether it is an IO-Link device of the same type (validation via vendor ID and device ID) no data storage
		Type compatible V1.1 device	<ul style="list-style-type: none"> IO-Link device is compatible with the V1.1 IO-Link standard Verification whether it is an IO-Link device of the same type (validation via vendor ID and device ID) no data storage
		Type compatible V1.1 device with Backup + Restore	<ul style="list-style-type: none"> IO-Link device is compatible with the V1.1 IO-Link standard Verification whether it is an IO-Link device of the same type (validation via vendor ID and device ID) The IO-Link master saves the parameter values of the connected IO-Link device; modifications of the parameter values are also stored (→ observe the note!) When connecting an IO-Link device with factory settings, the parameter values stored in the IO-Link master are restored automatically on the IO-Link device.

Parameter	Description	Possible values	
		Type compatible V1.1 device with Restore	<ul style="list-style-type: none"> ▪ IO-Link device is compatible with the V1.1 IO-Link standard ▪ Verification whether it is an IO-Link device of the same type (validation via vendor ID and device ID) ▪ The IO-Link master stores the parameter values of the connected IO-Link device once if the data memory of the AL1103 is empty. ▪ When connecting an IO-Link device with factory settings, the parameter values stored in the IO-Link master are restored automatically on the IO-Link device.
[Vendor ID (VID)]	ID of the manufacturer that is to be validated	0 ... 65535	ID of the manufacturer of the IO-Link device (ifm electronic: 310)
[Device ID]	ID of the IO-Link device that is to be validated	0 ... 16777215	ID of the IO-Link device
[IO-Link Events]	Enable / disable the transmission of IO-Link events	Disabled	IO-Link won't be transmitted
		Enabled	IO-Link events will be transmitted

* ... settings are only valid if [Fail Safe Mode] = Fail Safe with Pattern



If the parameter values of an IO-Link device are changed with `IO_LINK_DEVICE`, the backup mechanism remains ineffective. The changed parameter values are not stored on the IO-Link master.

13.2.2 Cyclic data

Content

PROFINET modules	52
PQI (Port Qualifier Information)	53

33814

PROFINET modules

34539

Module	Description	
IO-Link 32I/32O + PQI	IO-Link activated	32 bytes input and output data and PQI
IO-Link 16I/16O + PQI		16 bytes input and output data and PQI
IO-Link 8I/8O + PQI		8 bytes input and output data and PQI
IO-Link 4I/4O + PQI		4 bytes input and output data and PQI
IO-Link 2I/ 2O + PQI		2 bytes input and output data and PQI
IO-Link 1I/1O + PQI		1 byte input and output data and PQI
IO-Link 1I/15O + PQI		1 byte input and 15 bytes output data and PQI
IO-Link 32I + PQI		32 bytes input data and PQI
IO-Link 16I + PQI		16 bytes input data and PQI
IO-Link 8I + PQI		8 bytes input data and PQI
IO-Link 4I + PQI		4 bytes input data and PQI
IO-Link 2I + PQI		2 bytes input data and PQI
IO-Link 1I + PQI		1 bytes input data and PQI
IO-Link 32O + PQI		32 bytes output data and PQI
IO-Link 16O + PQI		16 bytes output data and PQI
IO-Link 8O + PQI		8 bytes output data and PQI
IO-Link 4O + PQI		4 bytes output data and PQI
IO-Link 2O + PQI		2 bytes output data and PQI
IO-Link 1O + PQI		1 bytes output data and PQI
DI + PQI		IO-Link deactivated
DO + PQI	Digital output and PQI	
Disabled	deactivated	

PQI (Port Qualifier Information)

34530

Port Qualifier Information (PQI) contains diagnostic information about the IO-Link port. In addition to the process data, the IO-Link master sends the PQI to the PROFINET controller.

Bit							
7	6	5	4	3	2	1	0
PQ	DE	DA	--	--	--	DI2	DI4

Legend:

- [DI4] Signal status of the digital input on pin 4 (DI)

FALSE	OFF
TRUE	ON
- [DI2] Signal status of the digital input on pin 2 (if used)

FALSE	OFF
TRUE	ON
- [DA] Device Available: shows if the IO-Link device has been recognised and if the device is in the "preoperate" or in the "operate" state

FALSE	no device
TRUE	device detected
- [DE] Device Error: shows if an error or a warning occurred; Note: The user needs to determine the cause of the fault separately via acyclic services.

FALSE	no error
TRUE	error detected
- [PQ] Port Qualifier: shows if IO data is valid

FALSE	invalid
TRUE	valid

13.2.3 Acyclic data

Content

I&M datasets.....	54
Diagnostic and alarms.....	56

33868

I&M datasets

34555

The AL1103 supports the following I&M datasets (I&M = Identification & Maintenance):

I&M0 (Slot 0)

34545

Variable	Description	Access*	Size
Vendor ID	IO-Link ID of the manufacturer	r	2
OrderID	Order number of the device (numbers are separated by blanks)	r	20
Serial number	Serial number of the device (numbers separated by blanks)	r	16
Hardware revision	Hardware revision of the device	r	2
Software revision prefix	Prefix of the software revision of the device (V, R, P, U or T)	r	1
Software Revision	Software revision (numbers separated by blanks, e.g. x y z in "Vx.y.z")	r	3
Revision Counter	Revision counter; is incremented with each parameter change	r	2
Profile ID	ID of sub-module profile (Slot 0: 0x0000)	r	2
Profile Specific Type	additional value for profile ID; 0, if not used	r	2
IMVersion	I&M version (default value: 0x0101)	r	2
IMSupported	Supported I&M datasets (0x1110 for I&M1-3)	r	2

* ... r = only read

I&M1 (Slot 0)

34543

Variable	Description	Access*	Size
TagFunction of submodule	function of the device (ASCII, padded with spaces)	r/w	32
TagLocation of submodule	Location of the device in the plant (ASCII, padded with spaces)	r/w	22

* ... r/w = read and write

I&M2 (Slot 0)

34544

Variable	Description	Access*	Size
Installation_Date	Installation date of the device (ASCII, padded with spaces)	r/w	16
	reserved	r/w	38

* ... r/w = read and write

I&M3 (Slot 0)

34550

Variable	Description	Access*	Size
Descriptor	Description of the device (ASCII, padded with spaces)	r/w	54

* ... r/w = read and write

I&M0 (Slot 1)

34542

Variable	Description	Access*	Size
Vendor ID	IO-Link ID of the manufacturer	r	2
OrderID	Order number of the device (numbers are separated by blanks)	r	20
Serial number	Serial number of the device (numbers separated by blanks)	r	16
Hardware revision	Hardware revision of the device	r	2
Software revision prefix	Prefix of the software revision of the device (V, R, P, U or T)	r	1
SOFTWARE_REVISION	Software revision (numbers separated by blanks, e.g. x y z in "Vx.y.z")	r	3
REVISION_COUNTER	Revision counter; is incremented with each parameter change	r	2
Profile ID	ID of the sub-module profile (Slot 1: 0x4E01 = IOLink)	r	2
Profile Specific Type	additional value for profile ID; 0, if not used	r	2
IMVersion	I&M version (default value: 0x0101)	r	2
IMSupported	Supported I&M datasets (0x0E for I&M1-3)	r	2

* ... r = only read

Diagnostic and alarms

34533

ECD code	Name	Description	Type
0x02	EVNT_CODE_M_PDU_CHECK	Receive frame with CRC error	Alarm
0x1B	EVNT_CODE_S_RETRY	Repetitions detected	Alarm
0x1E	EVNT_CODE_P_SHORT	Short circuit on C/Q cable detected	Diagnostics
0x1F	EVNT_CODE_P_SENSOR	Error in the sensor supply	Diagnostics
0x20	EVNT_CODE_P_ACTOR	Error in the actuator supply	Diagnostics
0x21	EVNT_CODE_P_POWER	Error in the power supply of the IO-Link master	Diagnostics
0x28	EVNT_CODE_DSREADY_NOACTION	Data storage completed, but no action, since CRC was correct	Alarm
0x29	DS_FAULT_IDENT	Sensor does not match the content of the data memory	Alarm
0x2A	DS_FAULT_SIZE	Sensor parameters too large for data memory	Alarm
0x2B	DS_FAULT_UPLOAD	Error during data memory transmission from the sensor	Alarm
0x2C	DS_FAULT_DOWNLOAD	Error during data memory transmission to the sensor	Alarm
0x2F	DS_FAULT_DEVICE_LOCKED	Error during data storage because the device is blocked	Alarm
0x32	EVNT_CODES_DSREADY_DOWNLOAD	Parameter transmission to the sensor finished	Alarm
0x33	EVNT_CODE_DSREADY_UPLOAD	Parameter transmission from the sensor finished	Diagnostics

14 Index

A

Accessories	43
Acyclic data	54
Appendix	44
Application	45
Approvals / tests	47

C

Cleaning process	39
Communication, parameter setting, evaluation	10
Configuration	22
Configure IO-Link devices	31, 36
Configure IO-Link ports	35
Configure the IO-Link master	34
Connect IO-Link devices for Class A operation	15
Connect the device	16
Cyclic data	52

D

Detect diagnostics and alarms	38
Diagnostic and alarms	56
Digital inputs	11

E

Electrical connection	13, 48
Electrical data	45
Ethernet interface	18
Ethernet ports	14
Explanation of Symbols	6

F

Factory settings	42
Fieldbus	
Set PROFINET interface	26
Firmware	
Reboot the device	30
Reset device to factory settings	30
Firmware update	40
Function	9

G

General	7
---------------	---

I

I&M datasets	54
I&M0 (Slot 0)	54
I&M0 (Slot 1)	55
I&M1 (Slot 0)	54
I&M2 (Slot 0)	54
I&M3 (Slot 0)	55
Inputs	46
Inputs / outputs	45
Install GSD Files	33
Integrate the IO-Link master in the project	33
Intended use	8
Interfaces	46
IO-Link	10

IO-Link ports	15
Activate data transfer to the LR SMARTOBSERVER	27
Configure operating mode	28
Set the device validation and data storage	29
IO-Link ports (Class A)	19
IO-Link supply	11
IoT	
Configure access rights	25
Configure the interface to the LR SMARTOBSERVER	26

L

LED indicators	18
Legal and copyright information	5
LR DEVICE	23

M

Maintenance, repair and disposal	39
Mechanical data	47
Modification history	6
Mount the device	12
Mounting	12

N

Notes	13
-------------	----

O

Offline parameter setting	24
Operating and display elements	17
Operating conditions	47
Outputs	46
Overview	17

P

Parameter data	49
Parameter of the IO-Link master	49
Parameter setting	10
Parameters of the IO-Link ports	50
Permitted use	8
PQI (Port Qualifier Information)	53
Preliminary note	5
PROFINET	10, 32, 49
PROFINET modules	52
Prohibited use	8
Purpose of the document	5

R

Read additional digital input	37
Read and write cyclic process data	37
Read device and diagnostic information	21
Read I&M datasets	38
Remarks	24
Replace IO-Link device	41
Required background knowledge	7

S

Safety instructions	7
Safety symbols on the device	7
Set-up	20
Status LEDs	18

T

Tampering with the unit	7
Technical data	45

V

Visual indication	10
Voltage supply	19
VPN connection	24