

Operating instructions  
Airflow monitor  
**SL5105**

**GB**

80007358 / 00 12 / 2021



## Contents

1	Preliminary note . . . . .	3
1.1	Symbols used . . . . .	3
2	Safety instructions . . . . .	4
3	Intended use . . . . .	5
4	Function . . . . .	6
5	Installation . . . . .	7
6	Electrical connection . . . . .	8
7	Settings . . . . .	9

# 1 Preliminary note

You will find instructions, technical data, approvals and further information using the QR code on the unit / packaging or at [www.ifm.com](http://www.ifm.com).

## 1.1 Symbols used

- ✓ Requirement
- ▶ Instructions
- ▷ Reaction, result
- [...] Designation of keys, buttons or indications
- Cross-reference
-  Important note  
Non-compliance may result in malfunction or interference.
-  Information  
Supplementary note

## 2 Safety instructions

- The unit described is a subcomponent for integration into a system.
  - The system architect is responsible for the safety of the system.
  - The system architect undertakes to perform a risk assessment and to create documentation in accordance with legal and normative requirements to be provided to the operator and user of the system. This documentation must contain all necessary information and safety instructions for the operator, the user and, if applicable, for any service personnel authorised by the architect of the system.
- Read this document before setting up the product and keep it during the entire service life.
- The product must be suitable for the corresponding applications and environmental conditions without any restrictions.
- Only use the product for its intended purpose (→ Intended use).
- Only use the product for permissible media.
- If the operating instructions or the technical data are not adhered to, personal injury and/or damage to property may occur.
- The manufacturer assumes no liability or warranty for any consequences caused by tampering with the product or incorrect use by the operator.
- Installation, electrical connection, set-up, operation and maintenance of the product must be carried out by qualified personnel authorised by the machine operator.
- Protect units and cables against damage.

### **3 Intended use**

The unit monitors airflows and switches a relay.

## 4 Function

- The unit detects flow based on the calorimetric measuring principle.
- The unit signals when a set airflow is reached by switching a relay and providing an LED signal:

Flow...	Output relay*	LED
above the set value	<ul style="list-style-type: none"><li>• Normally open: relay energises.</li><li>• Normally closed: relay de-energises.</li></ul>	green
below the set value	<ul style="list-style-type: none"><li>• Normally open: relay de-energises.</li><li>• Normally closed: relay energises.</li></ul>	red

\*Information on the unit type (NO or NC) → Technical data at <http://documentation.ifm.com>.

## 5 Installation

- ▶ Drill a hole with a diameter of 24 mm in the pipe.
- ▶ Mount the unit using the supplied mounting clamp:
  - Use the supplied seal for a hermetically sealed installation.
  - The sensor head must protrude completely into the airflow and should be in the area of the highest flow velocity. Installation depth: min. 32 mm, max. 120 mm.

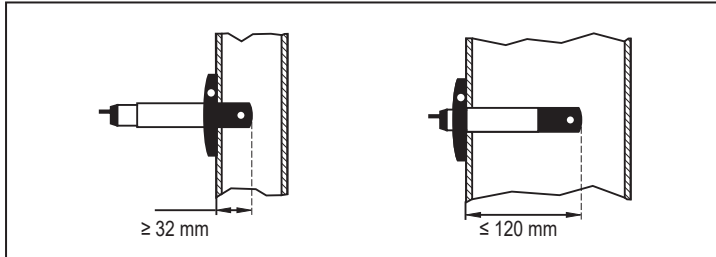


Fig. 1: Process connection, installation depth

- ▶ Align the unit in the airflow. The arrow on the cap must point in the direction of flow:

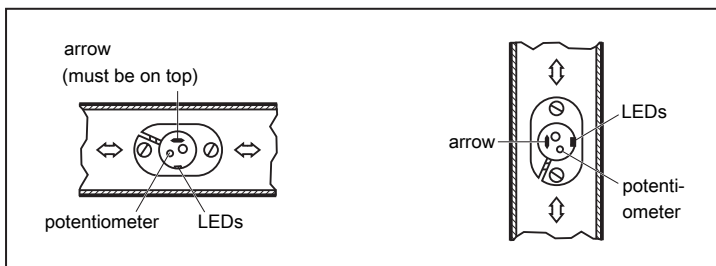


Fig. 2: Orientation

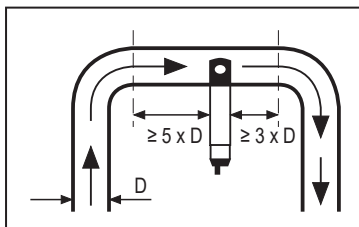


Fig. 3: Interference

Structures in the pipe, bends, valves, reducing pieces and the like affect the function of the unit.

- ▶ Adhere to the distances between sensor and interference.

## 6 Electrical connection



The unit must be connected by a qualified electrician.

Observe the national and international regulations for the installation of electrical equipment.

Voltage supply according to SELV, PELV.

The design of the unit complies with protection class II.

- ▶ Insert a miniature fuse according to IEC 60127-2 sheet 1 ( $\leq 5$  A fast acting), if specified in the data sheet.
- ▶ Check the safe functioning of the unit after a short circuit.
- ▶ Observe the applicable standards.
- ▶ Disconnect power.
- ▶ Connect the unit as follows:

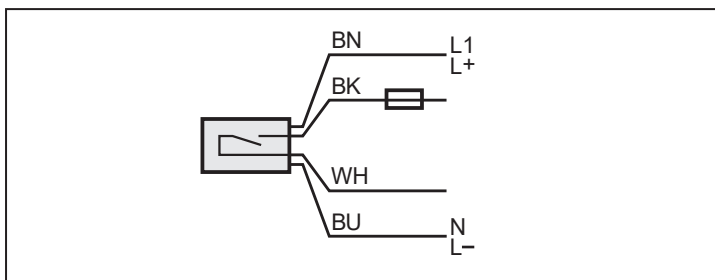


Fig. 4: Wiring diagram (colours to DIN EN 60947-5-2)

BK: black  
BU: blue

BN: brown  
WH: white



## 7 Settings

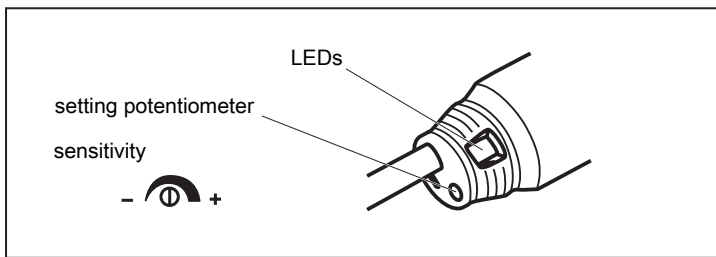


Fig. 5: Operating and display elements

Flow adjustment for setting the switching point:

- ▶ Switch on the power supply.
- ▶ Let the normal flow circulate in the installation and keep it constant.
- ▶ Continue with step 1 or 2.
  1. If the red LED is on:
    - ▶ Turn the potentiometer slowly clockwise until the red LED goes out and the green LED comes on.
  2. If the green LED is on:
    - ▶ Turn the potentiometer slowly anti-clockwise until the green LED goes out and the red LED comes on.
    - ▶ Turn the potentiometer slowly clockwise again until the red LED goes out and the green LED comes on.

If fluctuations which may result during operation shall be compensated for:

- ▶ When the green LED has come on, continue to turn the potentiometer clockwise.